















■ Features

- · Universal AC input / Full range
- Built-in active PFC function, PF>0.95
- · High efficiency up to 94%
- · Withstand 300VAC surge input for 5 seconds
- Protections: Short circuit / Overload / Over voltage / Over temperature
- Medical safety approved (2×MOPP)
- Suitable for BF application with appropriate system consideration
- · Built-in cooling fan ON-OFF control
- Current sharing up to 4000W (3+1)
- · Built-in DC OK signal
- Built-in remote ON-OFF control
- · Standby 5V@0.3A
- · Built-in remote sense function
- No load power consumption<0.75W (Note.6)
- 5 years warranty

Certificates

 Safety: ANSI/AAMI ES60601-1 IEC60601-1

• EMC: EN55032


Applications

- MRI scanne
- · CT and PET scanner
- · Medical bed
- Surgery table
- · Medical measurement device

Description

MSP-1000 is a single output enclosed type AC/DC power supply delivering 1000 W output power for a wide range of medical applications. The entire series operates for 90~264 VAC input voltage and supplies different output voltages between 12 V and 48 V that can satisfy the demands for all kinds of medical equipments. Meanwhile, the circuitry design meets the international medical standards, 2x MOPP, suitable for medical electrical devices. MSP-1000 is equipped with various built-in functions such as auxiliary power, remote sense and remote on-off control, offering vast design flexibility for the purpose of using control solutions.

■ Model Encoding / Order Information





SPECIFICATION

| MODEL | | MSP-1000-12 | MSP-1000-15 | MSP-1000-24 | MSP-1000-48 | | |
|------------|------------------------------|--|-------------------------------------|--------------------------|---|--|--|
| | DC VOLTAGE | 12V | 15V | 24V | 48V | | |
| | RATED CURRENT | 80A | 64A | 42A | 21A | | |
| | CURRENT RANGE | 0 ~ 80A | 0 ~ 64A | 0 ~ 42A | 0 ~ 21A | | |
| | RATED POWER | 960W (max. 1000W for 3 sec.) | 960W (max. 1000W for 3 sec.) | 1008W | 1008W | | |
| | RIPPLE & NOISE (max.) Note.2 | 150mVp-p | 150mVp-p | 200mVp-p | 250mVp-p | | |
| DUTPUT | VOLTAGE ADJ. RANGE | 11 ~ 14V | 14 ~ 17V | 22 ~ 28V | 46 ~ 56V | | |
| | VOLTAGE TOLERANCE Note.3 | ±2.0% | ±1.5% | ±1.0% | ±1.0% | | |
| | LINE REGULATION | ±0.5% | ±0.5% | ±0.5% | ±0.5% | | |
| | LOAD REGULATION | ±2.0% | ±1.5% | ±0.5% | ±0.5% | | |
| | SETUP, RISE TIME | | 000ms, 50ms/115VAC at full loa | | _ 0.070 | | |
| | HOLD UP TIME (Typ.) | 16ms/230VAC 16ms/115VAC at full load | | | | | |
| | () , | 90 ~ 264VAC(300VAC for 5 sec | | | | | |
| | | 47 ~ 63Hz | | | | | |
| | FREQUENCY RANGE | | | | | | |
| | POWER FACTOR (Typ.) | | 8/115VAC at full load | | | | |
| NPUT | EFFICIENCY (Typ.) | 91.5% | 92% | 93% | 94% | | |
| | AC CURRENT (Typ.) | 8.5A/115VAC 5A/230VAC | | | | | |
| | INRUSH CURRENT (Typ.) | 20A/115VAC 40A/230VAC | | | | | |
| | LEAKAGE CURRENT | Earth leakage current < 360 μA/ | 264VAC, Touch leakage current | < 100 µ A/264 VAC | | | |
| | OVERLOAD | 105 ~ 135% rated output power | r | | | | |
| | OVERLOAD | Protection type : Constant curre | nt limiting, recovers automatically | after fault condition is | removed | | |
| ROTECTION | | 14.5 ~ 16.5V | 18.2 ~ 20.6V | 29 ~ 33V | 58 ~ 65V | | |
| | OVER VOLTAGE | Protection type : Shut down o/g | voltage, re-power on to recove | r | - | | |
| | OVER TEMPERATURE | ••• | s automatically after temperatu | | | | |
| | CURRENT SHARING | Up to 4000W or (3+1) units. Plea | ase refer to the Function Manual. | | | | |
| | REMOTE ON-OFF CONTROL | . , , | open. Please refer to the Function | n Manual | | | |
| | REMOTE SENSE | · | • | | nuol | | |
| UNCTION | DC-OK SIGNAL | Compensate voltage drop on the load wiring up to 0.5V. Please refer to the Function Manual. | | | | | |
| | | The TTL signal out, PSU turn on = 3.3 ~ 5.6V; PSU turn off = 0 ~ 1V. Please refer to the Function Manual. 5VSB: 5V@0.3A; tolerance ±5%, ripple: 50mVp-p(max.) | | | | | |
| | 5V STANDBY | | | | | | |
| | FAN CONTROL | Fan on/off by NTC(RT50) or 30 | | | | | |
| | WORKING TEMP. | -40 ~ +70°C (Refer to "Derating Curve") | | | | | |
| | WORKING HUMIDITY | 20 ~ 90% RH non-condensing | | | | | |
| NVIRONMENT | STORAGE TEMP., HUMIDITY | -40 ~ +85°C, 10 ~ 95% RH non- | -condensing | | | | |
| | TEMP. COEFFICIENT | ±0.03%/°C (0~50°C) | | | | | |
| | VIBRATION | 10 ~ 500Hz, 5G 10min./1cycle, | 60min. each along X, Y, Z axes | | | | |
| | SAFETY STANDARDS | ANSI/AAMI ES60601-1, IEC606 | 01-1; CAN/CSA-C22.2 No.6060 | 1-1:14-Edition 3 appro | ved | | |
| | ISOLATION LEVEL | Primary-Secondary: 2×MOPP, Primary-Earth: 1×MOPP, Secondary-Earth: 1×MOPP | | | | | |
| | WITHSTAND VOLTAGE | I/P-O/P:4.5KVAC I/P-FG:2KVAC O/P-FG:1.5KVAC | | | | | |
| | ISOLATION RESISTANCE | I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH | | | | | |
| | | Parameter | Standard | | Test Level / Note | | |
| | EMC EMISSION | Conducted | | / EN55011 (CISPR11) | Class B | | |
| | | Radiated | ` ' | / EN55011 (CISPR11) | Class B | | |
| | | Harmonic Current | EN61000-3-2 | 7 ENGOGII (GIGI IVII) | Class A | | |
| | | | | | | | |
| | | Voltago i noto: | | | | | |
| SAFETY & | | EN60601-1-2 | 0, 1, 1 | | T (1 1/N (| | |
| MC () | | Parameter | Standard | | Test Level / Note | | |
| Note 8) | | ESD | EN61000-4-2 | | Level 4, 15KV air ; Level 4, 8KV contac | | |
| | | Radiated | EN61000-4-3 | | Level 3 | | |
| | EMC IMMUNITY | EFT / Burst | EN61000-4-4 | | Level 3 | | |
| | | Surge | EN61000-4-5 | | Level 4, 2KV/Line-Line 4KV/Line-Earth | | |
| | | Conducted | EN61000-4-6 | | Level 3 | | |
| | | Magnetic Field | EN61000-4-8 | | Level 4 | | |
| | | Voltage Dips and Interruptions | EN61000-4-11 | | 100% dip 1 periods, 30% dip 25 period 100% interruptions 250 periods | | |
| | MTBF | 286.3K hrs min. Telcordia SR-332 (Bellcore) ; 105.7K hrs min. MIL-HDBK-217F (25°C) | | | | | |
| THERS | DIMENSION | 218*105*63.5mm (L*W*H) | | | | | |
| CHILKS | | 1.53Kg;8pcs/13.3Kg/1.34CUFT | | | | | |
| | PACKING | | | | | | |


- 3. Tolerance : includes set up tolerance, line regulation and load regulation.
 4. Derating may be needed under low input voltages. Please check the derating curve for more details.
 5. Length of set up time is measured at first cold start. Turning ON/OFF the power supply may lead to increase of the set up time.
- 6. No load power consumption<0.75W when RC+ & RC- (CN100 pin3,4) open.
- 7. When the input voltage is less than 40VAC, the SPS may exhibit degradation of performance. The final product manufacturers must re-confirm this deviation that does not affect basic safety or essential performance.
- 8. The power supply is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on a 360mm*700mm metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com)

 9. The ambient temperature derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500ft).




■ Block Diagram


PWM fosc: 65KHz PFC fosc: 90KHz

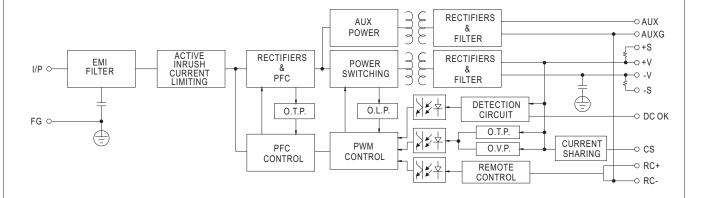

■ Derating Curve

■ Output Derating VS Input Voltage

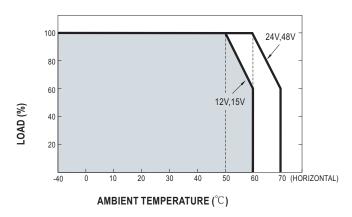





■ Function Description of CN100

| Pin No. | Function | Description | | |
|---------|----------|---|--|--|
| 1 | AUXG | Auxiliary voltage output ground. | | |
| 2 | AUX | Auxiliary voltage output, 4.75~5.25V, referenced to pin 1(AUXG). The maximum load current is 0.3A. This output is not controlled by the "remote ON/OFF control". | | |
| 3 | RC+ | Turns the output on and off by electrical or dry contact between pin 4 (RC-), Short: Power ON, Open: Power OFF. | | |
| 4 | RC- | Remote control ground. | | |
| 5 | cs | Current sharing signal. When units are connected in parallel, the CS pins of the units should be connected to allow current balance between units. | | |
| 6,8 | GND | This pin connects to the negative terminal(-V). Return for DC-OK signal output. | | |
| 7 | DC-OK | DC-OK signal is a TTL level signal, referenced to pin8(DC-OK GND). High when PSU turns on. | | |
| 9 | | Positive sensing. The +S signal should be connected to the positive terminal of the load. The +S and -S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V. | | |
| 10 | | Negative sensing. The -S signal should be connected to the negative terminal of the load. The -S and +S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V. | | |

■ Function Manual

1.Remote Sense

The remote sensing compensates voltage drop on the load wiring up to 0.5 V.

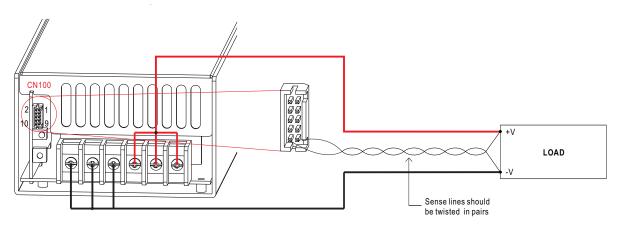


Fig 1.1

2.DC-OK Signal

 $\ensuremath{\mathsf{DC}\text{-}\mathsf{OK}}$ signal is a TTL level signal. High when PSU turns on.

| Between DC-OK(pin7) and GND(pin6,8) | Output Status |
|-------------------------------------|---------------|
| 3.3 ~ 5.6V | ON |
| 0 ~ 1V | OFF |

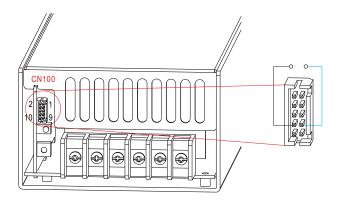


Fig 2.1




3.Remote ON-OFF Control

The PSU can be turned ON/OFF by using the "Remote Control" function.

| Transfer dentiles remotions | | |
|---------------------------------|---------------|--|
| Between RC+(pin3) and RC-(pin4) | Output Status | |
| | | |


| Between RC+(pin3) and RC-(pin4) | Output Status |
|---------------------------------|---------------|
| SW ON (Short) | ON |
| SW OFF (Open) | OFF |

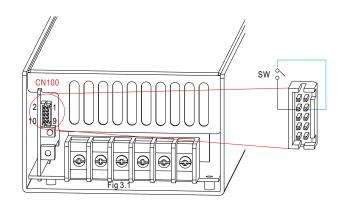

4. Current Sharing

MSP-1000 has the built-in active current sharing function and can be connected in parallel, up to 4 units, to provide higher output power as exhibited below:


- %The power supplies should be paralleled using short and large diameter wiring and then connected to the load.
- X Difference of output voltages among parallel units should be less than 0.2V.
- * The total output current must not exceed the value determined by the following equation: Maximum output current at parallel operation=(Rated current per unit) \times (Number of unit) \times 0.9
- the current shared among units may not be fully balanced.

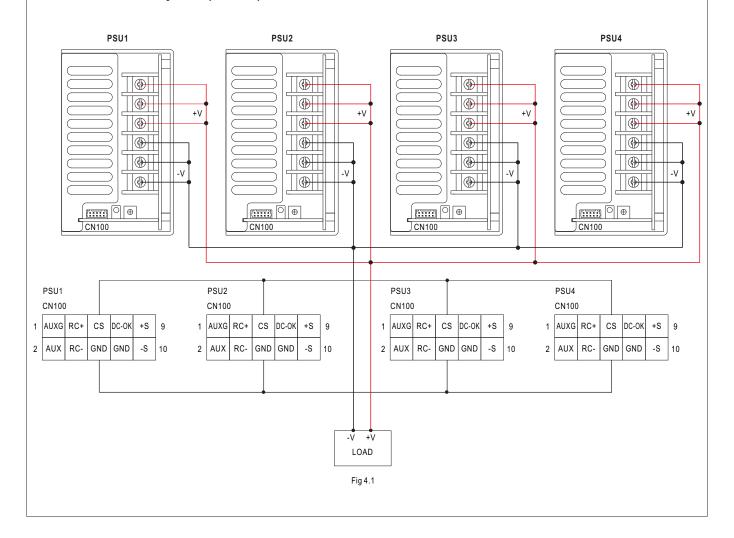



■ Mechanical Specification

Case No. 977 Unit:mm

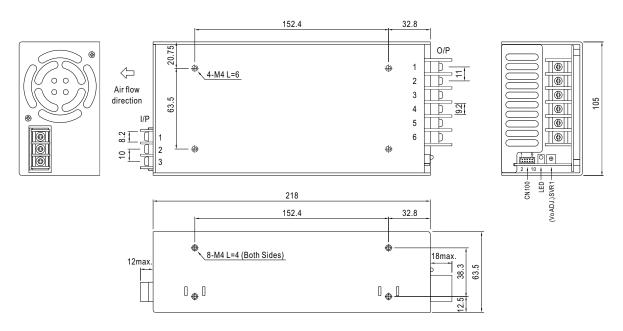

AC Input Terminal Pin No. Assignment

| | - | |
|---|---------|------------|
| Γ | Pin No. | Assignment |
| | 1 | AC/L |
| Γ | 2 | AC/N |
| Γ | 3 | FG ± |

DC Output Terminal Pin No.

| 7 toolgilliont | | | |
|----------------|------------|--|--|
| Pin No. | Assignment | | |
| 1~3 | +V | | |
| 4~6 | -V | | |

Connector Pin No. Assignment(CN100): HRS DF11-10DP-2DS or equivalent

| Pin No. | Assignment | Pin No. | Assignment | Mating Housing | Terminal |
|---------|------------|---------|------------|--------------------------------|-----------------------------------|
| 1 | AUXG | 6,8 | GND | HRS DF11-10DS or equivalent | -10DS HRS DF11-**SC or equivalent |
| 2 | AUX | 7 | DC-OK | | |
| 3 | RC+ | 9 | +S | | |
| 4 | RC- | 10 | -S | | |
| 5 | CS | | | | |

■ Installation Manual

Please refer to : http://www.meanwell.com/manual.html